

Appendix 6

Information requested by the
NPWS on emission
monitoring data Carranstown

Appendix 6. Additional information requested by the NPWS.

This appendix provide additional information on issues raised by the NPWS during consultation meetings. It addresses the following issues.

- Information on plant start-up and shut-down procedures including frequency of start-up and shut-down, and emergency response procedures (Requested at the NPWS meeting, May 2015). (**Appendix 6**)
- Information on air emission monitoring data from Indaver's plant at Carranstown, Co Meath. (Requested at the NPWS meeting, May 2015). (**Appendix 6**).
- Comparative data from similar waste-to-energy incinerator facilities (Point 3 of DAU letter). This information is provided in (**Appendix 6**).
- Effects of hazardous compounds (Point 8 of DAU letter). This is addressed in **Appendix 6**.

1. Plant start-up and shut-down procedures and frequency of start-up and shut-down, and emergency response procedures with particular reference to the paper by Wang (2007)

Furnace Start Up And Planned Shut Down Procedure

The start-up and shut down of the furnace will be carefully controlled, in accordance with standard operating procedures. The procedures will be developed in detail prior to the commissioning of the furnace. There is a maximum of two planned shutdowns per year and can be up to 5 in total, each of these is a controlled shutdown and start up as outlined in the procedure below

The start-up sequence for the furnace line will be as follows:

- The computerised control system for the line will be started up, which will mean that measurements and interlock systems will be in operation.
- Utilities for the plant such as water, electricity, instrument air, the firewater system and safety systems will then be started up.
- Monitoring of some of these utilities will be carried out, as certain conditions such as firewater availability must be satisfied before the start-up procedure can commence.
- Peripheral equipment, such as the equipment to supply chemicals to the plant, to receive the process steam from the plant and the stack emissions monitoring equipment will then be started up.
- After verification of process parameters such as liquid levels, pressures, steam cycle etc., and adjustment as necessary, the flue gas cleaning systems will be started up.
- The ID-fan will commence running and pre-ventilation of the line for a pre-set time period will occur.
- The oil-fired burners, to initiate the combustion in the furnace, will be started up and the flue gas temperature will be raised to 850°C at a gradient of 50°C per hour.
- Once the temperature in the furnace has stabilised, the supply of waste will then commence and oil firing will be stopped when the process is steady.

The planned shut down sequence for a furnace line will be as follows:

- The waste supply to the furnace will be shut off

- To ensure complete combustion of the waste remaining in the furnace, the oil burners will be re-started to ensure that a temperature of 850°C, as appropriate, will be maintained for a period of up to 1 hour or until all the waste is incinerated.
- The ID fan of the flue gas cleaning system will remain operating to ensure that the flue gases will be treated to the emission limits during the operation.
- The furnace will then be allowed to cool down to a temperature of 200°C at a gradient of 50°C per hour (a period of circa 13 hours) which will be controlled by supplementary firing.
- The furnace line will have stopped incinerating waste for a number of hours, there will be no waste remaining in the furnace and consequently there will be no flue gases to be cleaned. Once the temperature at the stack is sufficiently low at approximately 60°C, the flue gas cleaning systems will be stopped.
- Some utilities to the plant such as instrument air, etc. and the majority of the peripheral equipment will be shut-off.
- Other utilities such as electrical supply will continue operating as they will be required even when the plant is shut down.

Emergency Shutdown Procedure

The emergency shut down will bring the incinerator line to a safe status. The main objectives of the emergency shut down procedure are as follows:

- To shut down the plant safely, avoiding injury to staff or damage to equipment
- to minimise emissions
- to protect equipment from damage caused by temperatures which are too high.

The experience of the operators of Indaver's plants in Meath/Belgium is that an emergency shut down is not a frequent occurrence.

In case of failure of electrical power supply, the plant will switch over to island mode and power itself through the turbine. The plant will reduce in load and remain in a stable condition. If the turbine trips in this condition then the motors and equipment required for the emergency shut down will be powered by the emergency generator.

The emergency shut down will be automatically executed in two steps.

Step 1 is the waste burn out. As soon as the emergency shut down commences all waste supply will be stopped immediately. The ID-fan will be stopped. The water supply to the spray reactor will be stopped. An emergency supply may be provided for use in the spray reactor, if the temperature of the flue gases exceeds 250°C. This option will be decided at detailed design stage.

The injection of activated carbon/clay and lime will stop and may be reactivated by the operator, manually, once the reason for the shut down is known and it is determined that there will be no risk in doing so.

The inertia of the ID-fan will ensure that the flue gases will continue to be evacuated through the flue gas cleaning systems, prior to the start-up of the ID-fan via the auxiliary motor, which will be powered by the emergency generator.

In the grate furnace, air to burn out the residual waste will be drawn into the furnace because the inertia of the ID-fan will maintain under-pressure in the furnace. During this period the flue gas flow will drop quickly to less than 20 % of the normal flow. At this stage the waste in the furnace will be almost completely burned. Only a few bigger waste parts will still be smouldering. The auxiliary motor (with gear box) of the ID-fan will then engage and continue

on partial load. The power of this motor will be sufficient to evacuate the remaining flue gas through the flue gas cleaning system.

Step 2 is the cooling step. Once there is no more waste in the furnace, the ID fan will continue to pull air through the furnace boiler for a controlled cool down to protect the refractory and boiler from a rapid cool down which could lead to mechanical failure. The ID fan can then be stopped once the plant is below 60° C.

During any emergency shutdown, while there is waste in the furnace all the flue gases pass through the gas cleaning system and are emitted through the stack. As stated above, the ID Fan is kept operating during the shutdown by means of an auxiliary motor and an emergency generator. In the event of an emergency shutdown and failure of the emergency generator the inertia of the ID Fan would continue to draw the flue gases through the gas cleaning system for an initial period. It is highly unlikely that there would be both an emergency shutdown and a failure of the emergency generator at the same time.

While step 1 of the shutdown sequence is underway, the combustion gases will continue to pass through the flue gas cleaning systems and the bag house filter and particulates will be removed as efficiently as during normal operations (except in the case of catastrophic failure of the baghouse). The activated carbon/clay/lime mixture present on the sleeves of the bag house filter will continue to remove heavy metals, dioxins, HCl, HF and SO₂ from the combustion gases.

The fixed installed emissions monitoring equipment located on the stack will continue to monitor the emissions from the stack. In the event of loss of mains power, the monitoring equipment will be supplied with electricity from the Uninterruptible Power Supply (UPS) and emergency generator

A risk analysis will be carried out on this procedure during the detailed design phase of the project (in the form of a Hazard and Operability Study) during which the final details of the procedure will be decided.

Quick stop incineration

During the operation of the plant there can be conditions that force a scenario called quick stop incineration. These conditions are for example when the pressure increases in the furnace. If this occurs, the first stage alarm will indicate to the operator that the pressure is increasing and if no action is taken by the operator, then the second stage alarm will increase the ID fan speed to reduce the pressure. If this does not reduce the pressure then waste feeding will be stopped and the air supplied to the furnace for combustion will be reduced or stopped and the ID fan will reduce to ensure that the waste on the grate is still combusting in a controlled manner. The operator can then resolve the issue that led to the quick stop incineration conditions and return the plant to normal operating conditions.

The fixed installed emissions monitoring equipment located on the stack will continue to monitor the emissions from the stack during this time.

Assessment of the paper by Wang (2007)

The paper '*Influence of start-up on PCDD/F emission of incinerators*', Wang et al (2007) highlights the potential for dioxin production during a cold start up of an incinerator. It is noted that the paper does not provide information explaining the process conditions and process set-up details. More specifically the paper does not provide details on the following:

- year of construction of the plant
- secondary air mixing effect,
- residence time of flue gas at minimum 850°C,

- combustion temperature,
- calorific value of the waste,
- the equipment setup,
- information on boiler cleaning,
- quantity of activated carbon used,
- temperature in the flue cleaning,
- combustion air pre-heating or the presence of a bypass valve for flue gas over the dioxin abatement step.

As a lot of the potential reasons for poor control of dioxin levels are ignored in the article, it is problematic to accurately assess the validity of the paper. It is correct that in the absence of control measures, the cold start-up of the incinerator is favorable for dioxin production. It is also correct that some materials absorb dioxins and release dioxins (memory effect). However these effects are effectively negated by the control measures as detailed below. These measures ensure that excess emissions of dioxins do not occur during start-up procedures.

1. The number of cold starts is limited to a minimum. The maintenance strategy is focused on a high plant availability. This is only possible with a low frequency of unscheduled shut downs and cold start-ups.
2. Cold startup is done through the bag filter. The filter cake is not removed or a filter cake is applied in case of new filter bags. It contains activated carbon and this abates dioxins. The flue gas cleaning residue is mainly re-circulated in order to get a better use of the carbon and lime. The carbon dosing can be started if necessary to ensure there is no bypass of the dioxin abatement step during a cold start. Hence the downstream equipment is not exposed to increased dioxin concentrations and the memory effect does not occur.
3. The combustion chamber is state of the art. Geometry and flow patterns are also designed to limit undesirable conditions for burnout at cold start up.
4. Fuel burners are selected with a low CO and NOx production in cold start conditions. This reduces also the amount of dioxin precursors.
5. The bag filter is pre-coated with a lime/carbon/residue mixture prior to cold startup. The carbon concentration is higher than during normal operation with waste.
6. The plant is designed and operated with a big margin below the dioxin emission limit. The limit is 0.1 ng TEQ / Nm³. The plant is operated with an emission of less than 10 % of this emission limit in order to absorb unwanted events or suboptimal process conditions.
7. Materials that absorb dioxins and release it as memory effect are avoided.
8. The boiler has fixed installed cleaning devices. Before a shut down extra cleaning cycles will be executed. During the shutdown the boiler will be cleaned manually if the fouling is abnormal.

2. Data from other European sites

Indaver and the project team met representatives of the National Parks and Wildlife Service (NPWS) in April 2015. At the meeting, the NPWS representative suggested that data on the monitoring of the effects of waste to energy plants on nearby special protection areas would be useful. Indaver/ARUP carried out a desktop review to identify incinerators in proximity to SPAs in Europe. A recent International Solid Waste Association report provided information on over 472 plants in 18 European countries (Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Hungary, Italy, Ireland, Netherland, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom). Each of the plants is treating more than 100,000 tonnes per annum of municipal solid waste.

A closer look identified over 60 of these that were within 15km of special area of conservation (SPA) (See **Table 1**). In Belgium, France and the UK examples of incinerators can be found located within less than 0.5km of an SPA and the results suggest that proximity to an SPA does not, in general, create a significant barrier to permission being granted to incinerators in proximity to SPAs. Indaver contacted representatives of the waste-to-energy industry in the UK, Ireland, Germany, Belgium and The Netherlands but found no evidence for a biomonitoring programme instigated by a specific incinerator. The general consensus was that such programmes are not required due to the low emission levels and the low potential for impacts.

Indaver specifically contacted the following waste to energy facilities:

- (a) *Runcorn municipal waste incinerator (Cheshire, UK), within 300m of the Mersey Estuary SPA;*
- (b) *Marchwood Energy from Waste Facility (Southampton, UK), within 1km of the Solent and Southampton Water SPA;*
- (c) *Exeter Energy from Waste facility (Devon, UK), within 2km of the Exe River SPA;*
- (d) *La Collete non-hazardous waste incinerator facility (Jersey, UK), near to the South East coast of Jersey Ramsar site.*

It is Indaver's understanding that the facilities noted above do not have ecological data on the impact of operating incinerators collated to support the conclusion of the Appropriate Assessment. No specific bio-monitoring programmes to monitor the effects of the operations on the nearby SPA are implemented by these plants. All of the incinerators proposals were subject to a full assessment as part of the planning and licencing procedures.

Table 1: List of European incinerator facilities located within 15km distance from special protection areas for birds.

Country	Location	Name of Plant	Year of Establishment	SPA Code	Distance from SPA (KM)
Austria	Wels (I) & Wels (II)	WAV I & WAV II	1995 & 2006	<u>AT3113000</u>	7.2
				<u>AT3126000</u>	2.4
	Arnoldstein	TBA Arnoldstein	2004	<u>AT2116000</u>	7.0
Belgium	Wilrijk (Antwerpen)	ISVAG	1999-2000	<u>BE2301336</u>	12.0
				<u>BE2300222</u>	7.2
				<u>BE2301235</u>	4.7
	Eeklo	IVM	1982	<u>BE2500932</u>	13.0
				<u>BE2301134</u>	4.3
	Gent	IVAGO	1996	<u>BE2301235</u>	11.7
	Oostende	IVOO	1981	<u>BEMNZ0003</u>	4.3
	Herstal	Uvelia-Intradel	2009	<u>BE33004A0</u>	3.9
Houthalen	Bionerga	1984	<u>BE2200727</u>	0.5	
Finland	Vaasa	Westenergy Oy Ab	2013	<u>FI0800056</u>	4.89
				<u>FI0800057</u>	12.7
Denmark	Aars	Aars Fjernvarmeværk	1986-1995	<u>DK00FX001</u>	12.5
	Aalborg	Reno-Nord I/S	1991-2005	<u>DK00FX001</u>	12.1
				<u>DK00FX007</u>	12
	Nykøbing F	I/S REFA	1983-1999	<u>DK006X085</u>	13.6
				<u>DK006X083</u>	4.5
				<u>DK006X086</u>	1.5
	Næstved	AffaldPlus Næstved	1995-2005	<u>DK006X081</u>	0.6
				<u>DK005X096</u>	11.6
				<u>DK006Y093</u>	12.1
	København	I/S Amagerforbrænding	1971	<u>DK002X110</u>	5.3
				<u>DK002X111</u>	6.9
	Roskilde	KARA/NOVEREN Roskilde forbrændingsanlæg	1980-1988	<u>DK004Y105</u>	2.7
Slagelse	AffaldPlus Slagelse	1990	<u>DK005X100</u>	12	
			<u>DK006Y093</u>	13.5	
Horsens	Horsens Kraftvarmeværk A/S	1992	<u>DK00DY036</u>	6.6	
France	Saint Pourcain sur Sioule	Bayet	1982-1988	<u>FR8310079</u>	3.2
	La Rochelle	La Rochelle	1988	<u>FR5410100</u>	12.2
				<u>FR5410013</u>	10.5
				<u>FR5412026</u>	0.5
	Plouharnel	Plouharnel	1971	<u>FR5310086</u>	9.6
				<u>FR5310093</u>	2.0
<u>FR5310094</u>				12.3	

Country	Location	Name of Plant	Year of Establishment	SPA Code	Distance from SPA (KM)
	Thonon Les Bains Cedex	Thonon Les Bains	1988	FR8212020	0.3
				FR8210018	0.4
	Bayonne	Bayonne	1990	FR7210063	8.4
				FR7212002	10.3
	Lens	Noyelles sous Lens	1973	FR3112002	14.2
	Planguenoual	Lamballe (Planguenoual)	1993	FR5310050	8.4
	Concarneau	Concarneau	1989	FR5310057	2.4
	Monthyon	Monthyon (Somoval)	1997-1998	FR1112003	7.4
	Sète	Sète	1992	FR9110042	6.9
				FR9112018	1.1
				FR9112035	1.2
	Brest	Brest	1988	FR5310071	10.4
	Fourchambault	Nevers (Sonirval)	2002	FR2610004	1.1
	Montereau Fault Yonne	Montereau	1973	FR1112002	0.0
				FR1112001	9.5
				FR1110795	13.1
	Saran	Saran (Orléans)	1995	FR2410017	5.8
	Villefranche sur Saône	Villefranche/Saône	2002-2003	FR8212016	9.2
	Livet	Bourg d'Oisans	1998	FR9310036	13.8
Pontcharra	Pontcharra	1977	FR8212003	13.4	
Toulouse Mirail	Toulouse	2003-2006	FR7312014	3.1	
Douchy les Mines	Douchy	1977	FR3112005	9.3	
Germany	Premnitz	E.ON energy from waste Premnitz GmbH	2009	DE3339402	0.6
				DE3542421	12.6
				DE3341401	9.2
	Darmstadt	Müllheizkraftwerk Darmstadt	1967-1977	DE6116450	13.2
				DE6217403	8.1
				DE6119401	13.1
				DE6017401	8.3
Würzburg	Müllheizkraftwerk Würzburg	1984-1998	DE6027471	13.7	
Ireland	Carranstown, Duleek	Meath Waste-to-Energy Plant	2011	IE0004080	9.4
				IE0004232	5.0
				IE0004158	10.3
Italy	Padova	Padova	1970-2000	IT3260018	6.4
	Venezia	Fusina	1998	IT3250046	1.6
	Trieste	Trieste	2000-2004	IT3341002	3.3
				SI5000008	7.6
	Reggio Emilia	Reggio Emilia	2004-2005	IT4030023	14.8
IT4020027				16.2	

Country	Location	Name of Plant	Year of Establishment	SPA Code	Distance from SPA (KM)
				<u>IT4030011</u>	14.2
	Milano	Milano	2009	<u>IT2050006</u>	9.1
				<u>IT2050401</u>	6.1
	Livorno	Livorno	2003	<u>IT5170002</u>	3.1
				<u>IT5160001</u>	2.5
	Ospedaletto (PI)	Ospedaletto	2000	<u>IT5170002</u>	3.1
				<u>IT5160001</u>	5.8
	Trezzo sull	Trezzo sull'Adda	2002	<u>IT2030008</u>	14.0
	Dalmine (BG)	Dalmine	2001	<u>IT2030008</u>	15.8
	Messina	Messina	1979	<u>ITA030042</u>	0.0
	Modena	Modena	1994-1995	<u>IT4030011</u>	4.4
				<u>IT4040010</u>	16.3
				<u>IT4040011</u>	10.5
	Melfi (PZ)	Melfi	1999	<u>IT9210201</u>	7.2
<u>IT9210210</u>				5.0	
Roma	Roma	1996	<u>IT6030085</u>	13.4	
Coriano (RN)	Coriano	1994-2001	<u>IT5310025</u>	8.4	
Sweden	Malmö	SYSAV Sydskånes Avfallsaktiebolag	1973	<u>DK002X110</u>	13.7
				<u>SE0430091</u>	10.1
				<u>SE0430002</u>	14.1
				<u>SE0430173</u>	1.0
	Helsingborg	Filborna KVV1	2013	<u>SE0430125</u>	16.5
	Jönköping	Jönköping Energi	2006	<u>SE0310221</u>	9.6
	Karlskoga	Karlskoga Kraftvärmeverk	1986	<u>SE0240052</u>	1.8
				<u>SE0240022</u>	14.4
Mora	Utmeland Avfallsanläggning	1981	<u>SE0620322</u>	8.0	
UK	Runcorn	Cheshire		<u>UK9005131</u>	0.4

3. Summary of air emission monitoring data from Indaver Carranstown, Co Meath.

The waste-to-energy plant at the Ringaskiddy Resource Recovery Centre will be very similar to the Indaver Carranstown, Co Meath, plant, which is currently operating. Air emission monitoring data from the Indaver Carranstown, Co Meath, plant is provided in **Figures 1,2 and 3**. The following data are provided;

- Dioxin emissions in 2012, 2013 and 2014, relative to the licensed emission limit
- Daily average emissions of all licensed substances in 2014, relative to the licensed emission limits
- Volume of pollutants emitted in 2014.

The data show that the concentration of dioxins in emissions from the plant, in the years 2012, 2013 and 2014, were substantially less than one tenth of the licensed emission limit value. For the year 2014, the daily average emissions of dust, metals, acid gases, carbon monoxide, sulphur dioxide and nitrous oxides from the facility complied with the licensed emission limit values.

Figure 1. Dioxin emissions in 2012, 2013 and 2014, relative to the licensed emission limit

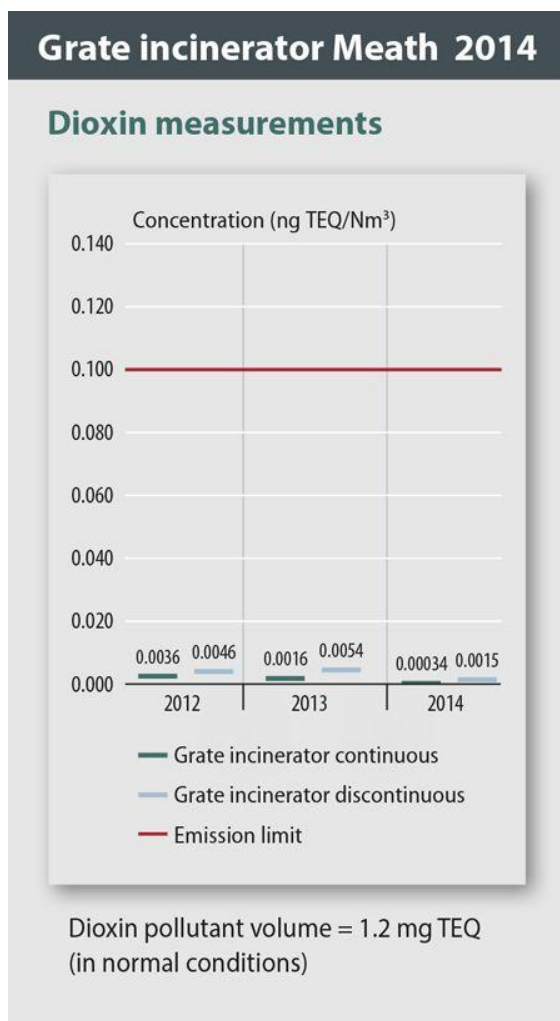


Figure 2. Daily average emissions of all licensed substances in 2014, relative to the licensed emission limits

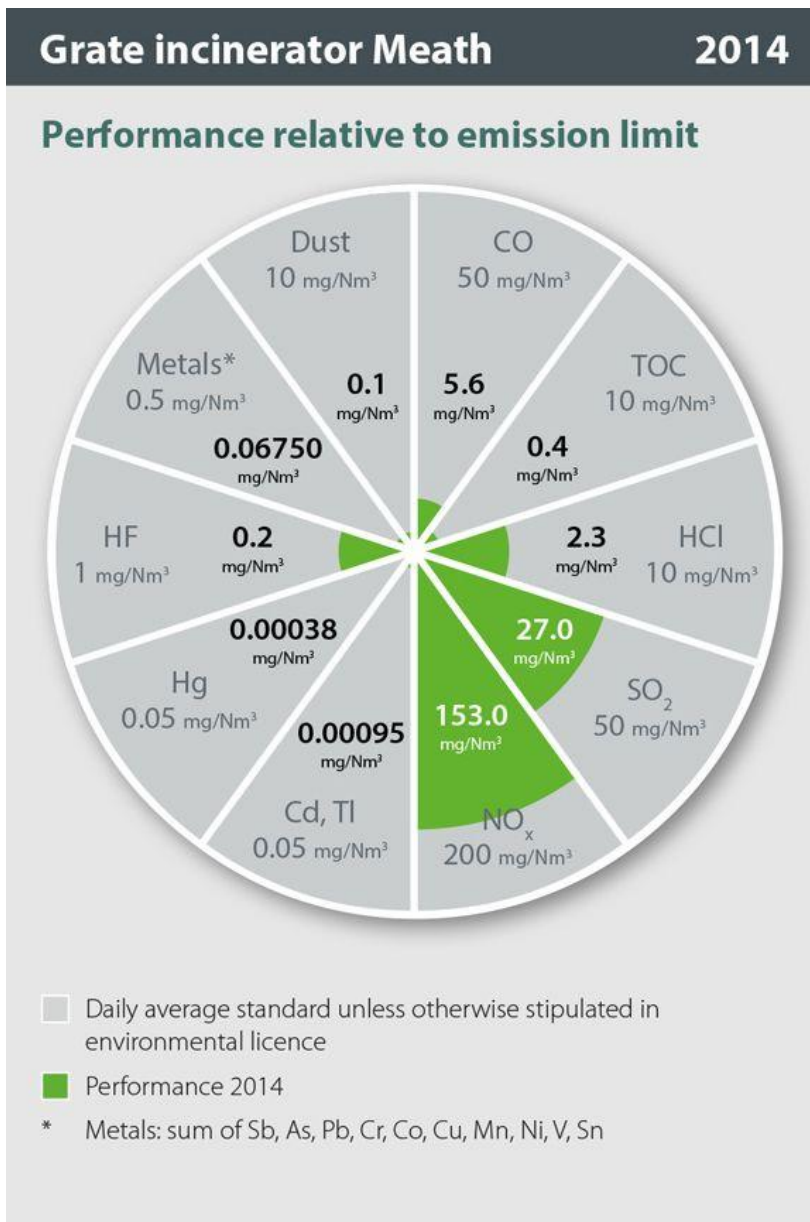


Figure 3. Volume of pollutants emitted in 2014.

Meath		2014
Grate incinerator		
Volume of pollutants		
Dust	0.1	
CO	7.2	
TOC	0.5	
HCl	3.0	
SO ₂	35.7	
NO _x	199.3	
Cd, Tl	0.0012	
Hg	0.0005	
Metals*	0.089	

* Metals: som van Sb, As, Pb, Cr, Co, Cu, Mn, Ni, V, Sn

Volumes of pollutants from contaminated components (in tonnes)

4. Potential Effects of hazardous compounds

Grate furnaces are used for the destruction of a wide variety of waste streams and are a well-recognised, robust and established technology for these purposes. Waste is burned on the grate for a period of 1 hour approximately, and the resultant flue gases must maintain a temperature of 850°C for a minimum of 2 seconds after the last injection of air to ensure complete combustion of any volatiles and unburned flue gas components. In reality the flue gas temperatures range from 850°C to 1,200°C in the combustion zone above the grate. These temperatures ensure destruction of organics and other flue gas components. Consequently a hazardous substance that is fed into the furnace does not come out unchanged as the same hazardous substance, either in the residues or in the exhaust gases. In the furnace the hazardous substance is oxidised which means it undergoes a chemical reaction and is converted into one or more different substances with different properties. These different substances are removed in the ash or flue gas cleaning residues and a very small quantity is discharged to the air in the exhaust gases. Compounds such as dioxins which form after combustion is complete (and at lower temperature windows in the boiler of around 450°C) are removed by the injection of activated carbon/clay.